


3Ø PADMOUNTED TRANSFORMER PIT  
(112 TO 500 KVA)



CONCRETE PIT

FIBERGLASS PIT

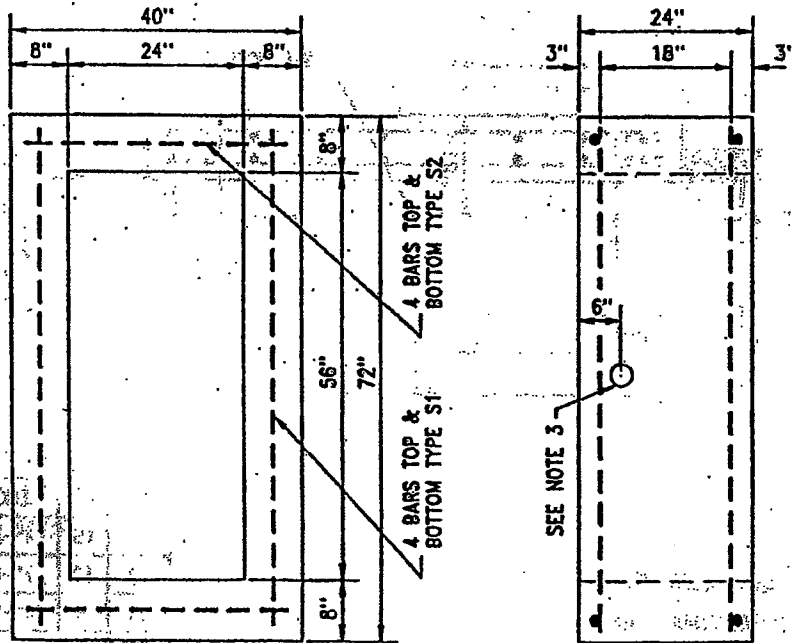

ALL REBAR #5Ø

REINFORCING SCHEDULE		
TYPE NO.	LENGTH	TOTAL
S1	56"	22.6'
S2	36"	12'-0"
CONC. VOLUME=		79 c.y.

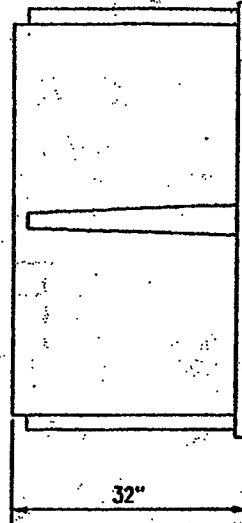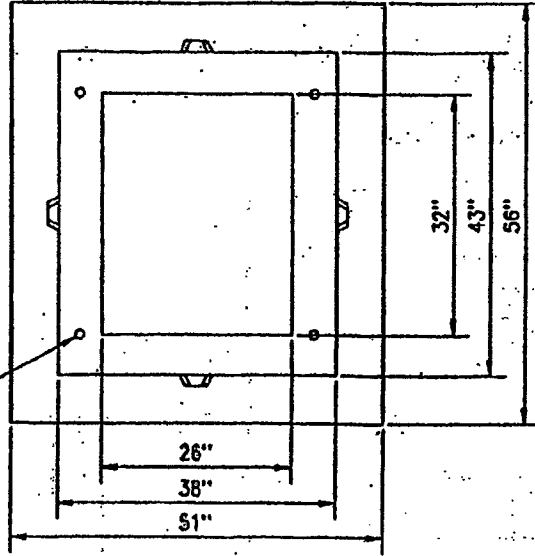

53110

- NOTES:
1. SEE DWG. 53101 REQUIREMENTS FOR SLAB DETAILS.
  2. SEE DWG. 53106 AND 107 FOR SLAB DETAILS.
  3. 1" PVC CONDUIT FOR GROUNDING LEADS.
  4. ALL REBAR #5Ø.



Public Service  
of New Hampshire

CONSTRUCTION REQUIREMENT

ISSUE	DATE
Original	4/1/80
Rev.	3/1/83