


PLAN VIEW

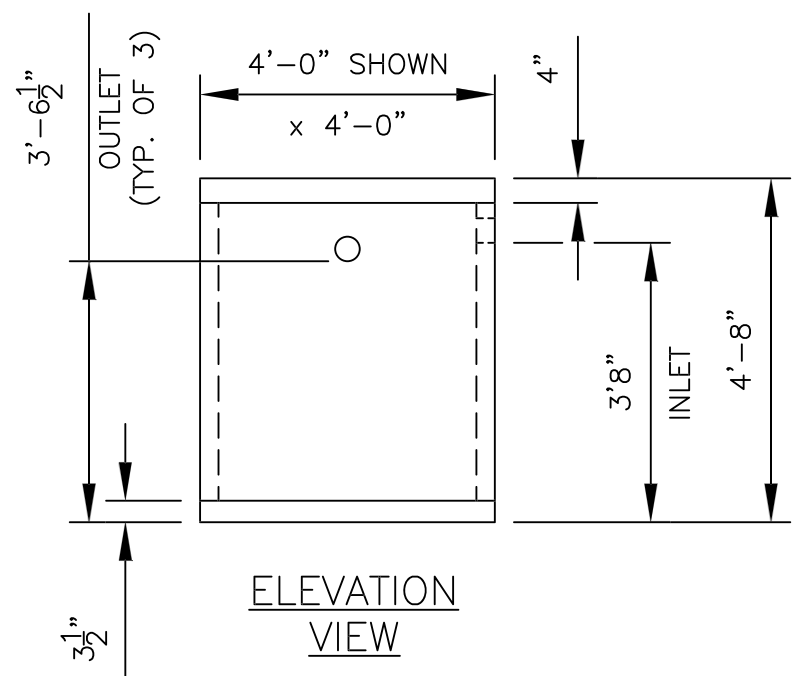

ELEVATION VIEW

- NOTES:
1. CONCRETE: 5,000 PSI MIN AFTER 28 DAYS.
  2. TYPE III CEMENT.
  3. TEST BAFFLES SOLD SEPARATELY.
  4. 4" POLYLOK IV CLOSED END BOOTS USED FOR CONNECTIONS.
  5. JOINT SEALED WITH BUTYLE RESIN.
  6. PUMPS & ACCESSORIES OPTIONAL
  7. PLASTIC RISER CAN BE POURED INTO COVER.

REV. NO.	DATE	REVISION

PREPARED BY:

**DELTA**  
ENGINEERS, ARCHITECTS, & LAND SURVEYORS  
184 COURT STREET, BINGHAMTON, NY 13901  
TEL: (607) 231-6600 FAX: (607) 231-6650

PREPARED FOR:  
**ANDREW J. FOSS CO. INC.**  
100 CONCHECO ROAD  
FARMINGTON, NH 03835  
PHONE(603)755-2515 FAX(603)755-9249

DATE: 9/18/09	SHEET TITLE: SKETCH	DRWN BY: GJP
SCALE: N.T.S.		CHK BY: KMK
PROJECT: 300 GALLON PUMP BOX 4'-0"x4'-0"x4'-8" H-10		
CONTRACTOR:	DWG. LD. SK-01	
DELTA PROJ. NO.: 2009.367.001	SHT. NO. 1 OF 1	