


PLAN VIEW

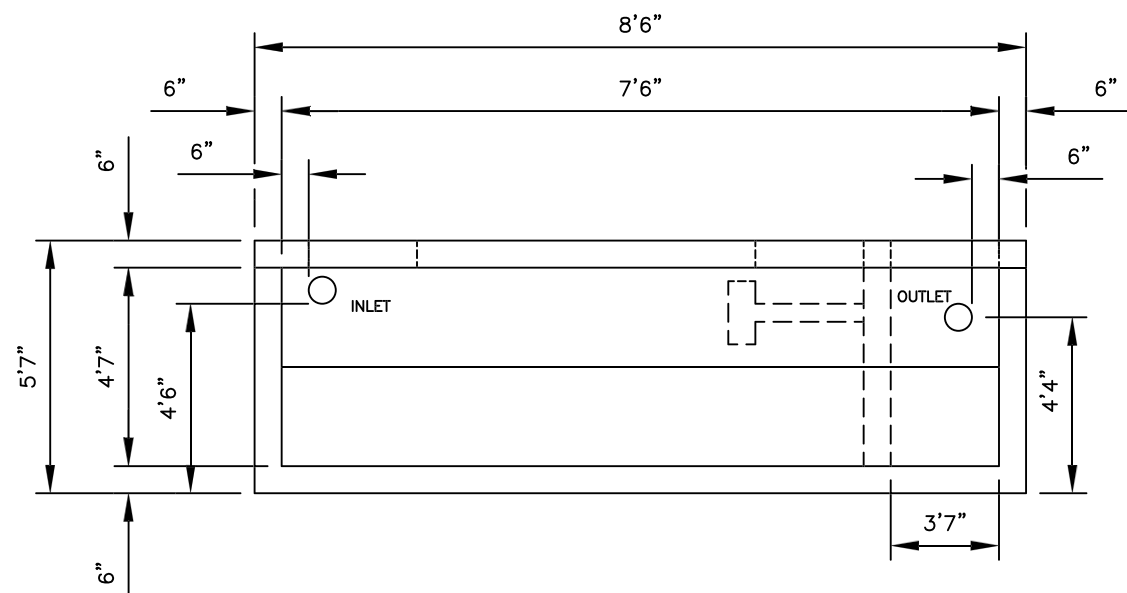

ELEVATION VIEW

- NOTES:
1. CONCRETE: 5,000PSI MIN AFTER 28 DAYS.
 2. ALL REINFORCEMENT PER ASTM C1227-93.
 3. TEES AND GAS BAFFLE SOLD SEPARATELY.
 4. TONGUE & GROOVE JOINT SEALED WITH BUTYLE RESIN.
 5. 4" POLYLOK IV CLOSED END BOOTS USED FOR CONNECTIONS.
 6. PLASTIC RISER CAN BE POURED INTO COVER.
 7. PUMPS & ACCESSORIES OPTIONAL

REV.NO.			DATE			REVISION		
PREPARED BY:								
 DELTA ENGINEERS, ARCHITECTS, & LAND SURVEYORS 184 COURT STREET, BINGHAMTON, NY 13901 TEL: (607) 231-6800 FAX: (607) 231-6850								
DATE: 9/16/09			SHEET TITLE: SKETCH			DRWN BY: GJP		
SCALE: N.T.S.						CKD BY: KMK		
PROJECT: 500 GALLON TANK 500 GALLON CHAMBER H-20								
CONTRACTOR:						DWG. I.D. SK-01		
DELTA PROJ. NO.: 2009.367.001						SHT. NO. 1 OF 1		

PREPARED FOR:
ANDREW J. FOSS CO. INC.
 100 COCHECO ROAD
 FARMINGTON, NH 03835
 PHONE(603)755-2515 FAX(603)278-7878