
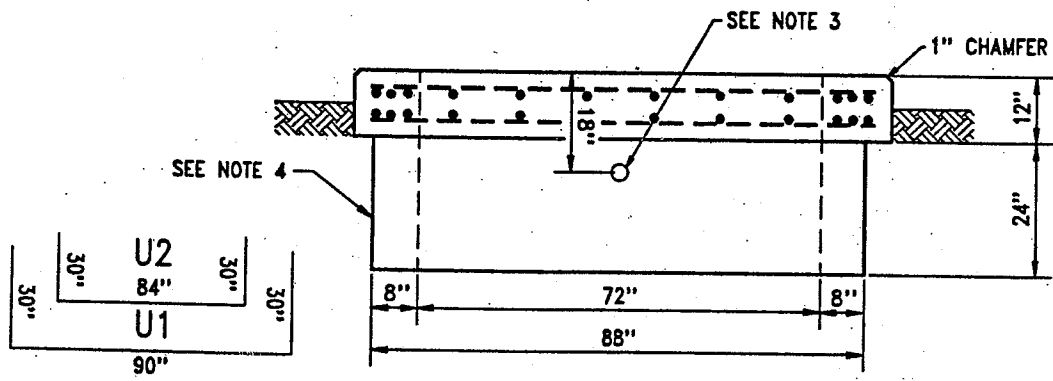


# 3Ø PADMOUNTED TRANSFORMER SLAB DETAIL (750 TO 2000 KVA DEAD FRONT) CONCRETE PIT

(53)112

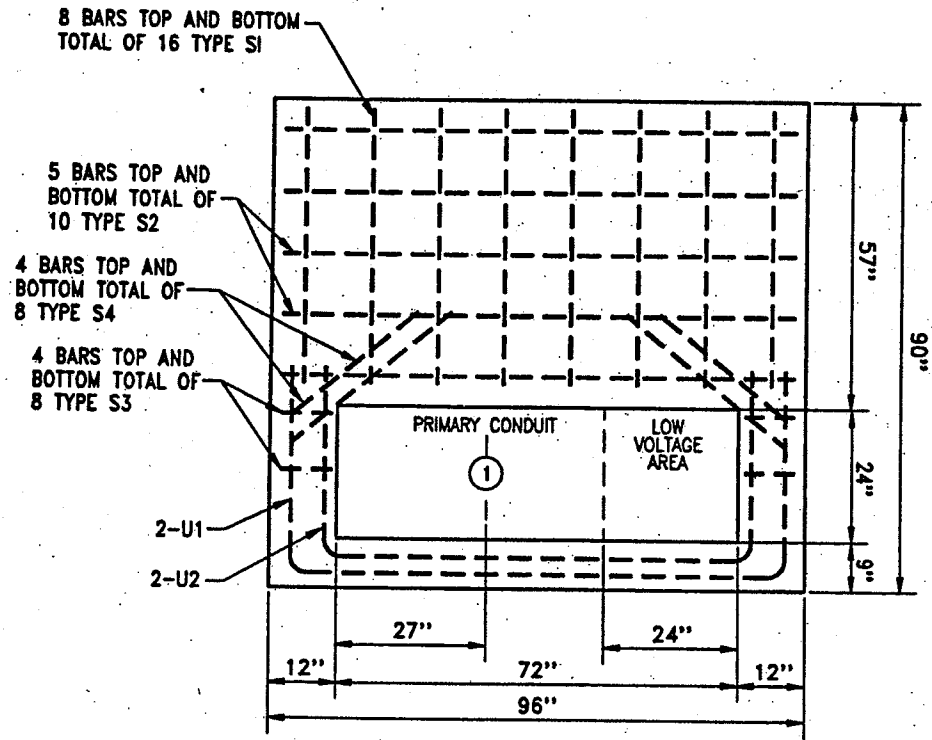

**NOTES:**

1. SEE PRINT (53) 101 REQUIREMENTS FOR SLAB DETAILS.
2. SEE PRINT (53) 120 FOR GROUNDING GRID.
3. 1" PVC CONDUIT FOR GROUND LEADS.
4. ALL REBAR TO BE #5Ø.
5. SEE (53) 113 FOR PIT DETAIL.

REINFORCING SCHEDULE			
TYPE	NO.	LENGTH	TOTAL
S1	16	4'-3"	88'-0"
S2	10	7'-6"	75'-0"
S3	8	0'-6"	4'-0"
S4	8	2'-0"	16'-0"
CONC. VOLUME=1.78 c.y. TOP SECTION ONLY			



DISTRIBUTION STANDARDS

ISSUE	DATE
R2	4-90
ORIGINAL 5-84	